
CITY OF BANNING ELECTRIC UTILITY

THIS STANDARD SHOWS THE REQUIREMENTS FOR AN 8' x 14' x 9'-6" PRECAST CONCRETE MANHOLE.



- LOCATE VAULT AS DIRECTED BY C.O.B. ELECTRIC UTILITY.
- INSTALL GROUNDING SYSTEM PER C.O.B. STANDARD DRAWING #600-21.
- INSTALL A MINIMUM 8" OF 3/4" CRUSHED ROCK UNDER VAULT.
- ALLOW UP TO 3" OF EXTRA EXCAVATION DEPTH FOR ADJUSTING LID UP TO FINAL GRADE.
- BACKFILL AROUND STRUCTURE WITH ONE-SACK CEMENT SLURRY TO WITHIN ONE FOOT OF FINAL GRADE.
- 6. INSTALL LADDER INSIDE VAULT, DIRECTLY UNDER MANHOLE OPENING.
- PROVIDE UNOBSTRUCTED SPACE CLEARANCES AROUND VAULT PER SD #600-72.

REF: 3325.1

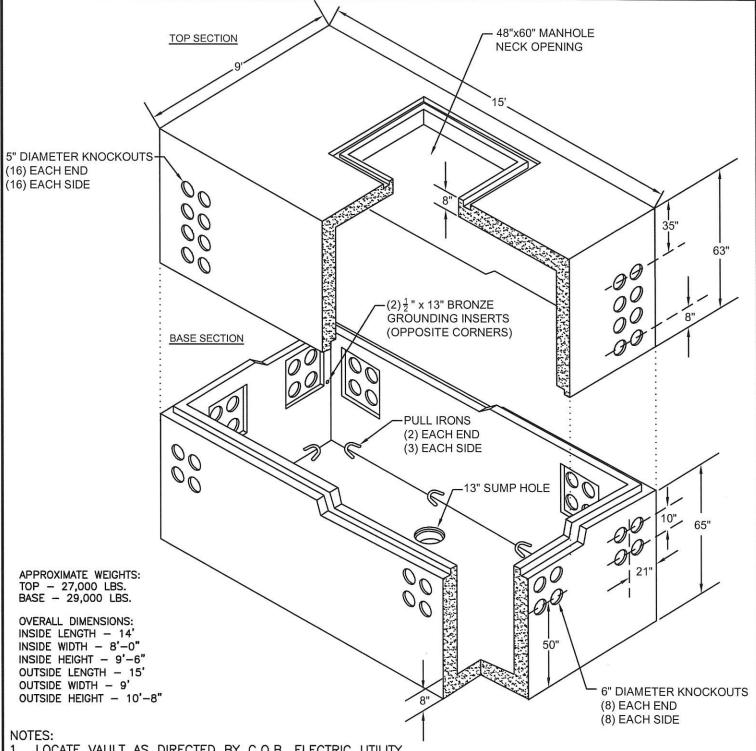

REVISED: 08/13/2019

APPROVED:

STANDARD DRAWINGS

PRECAST CONCRETE MANHOLE BODY, 8' x 14' x 9'-6"

600-57